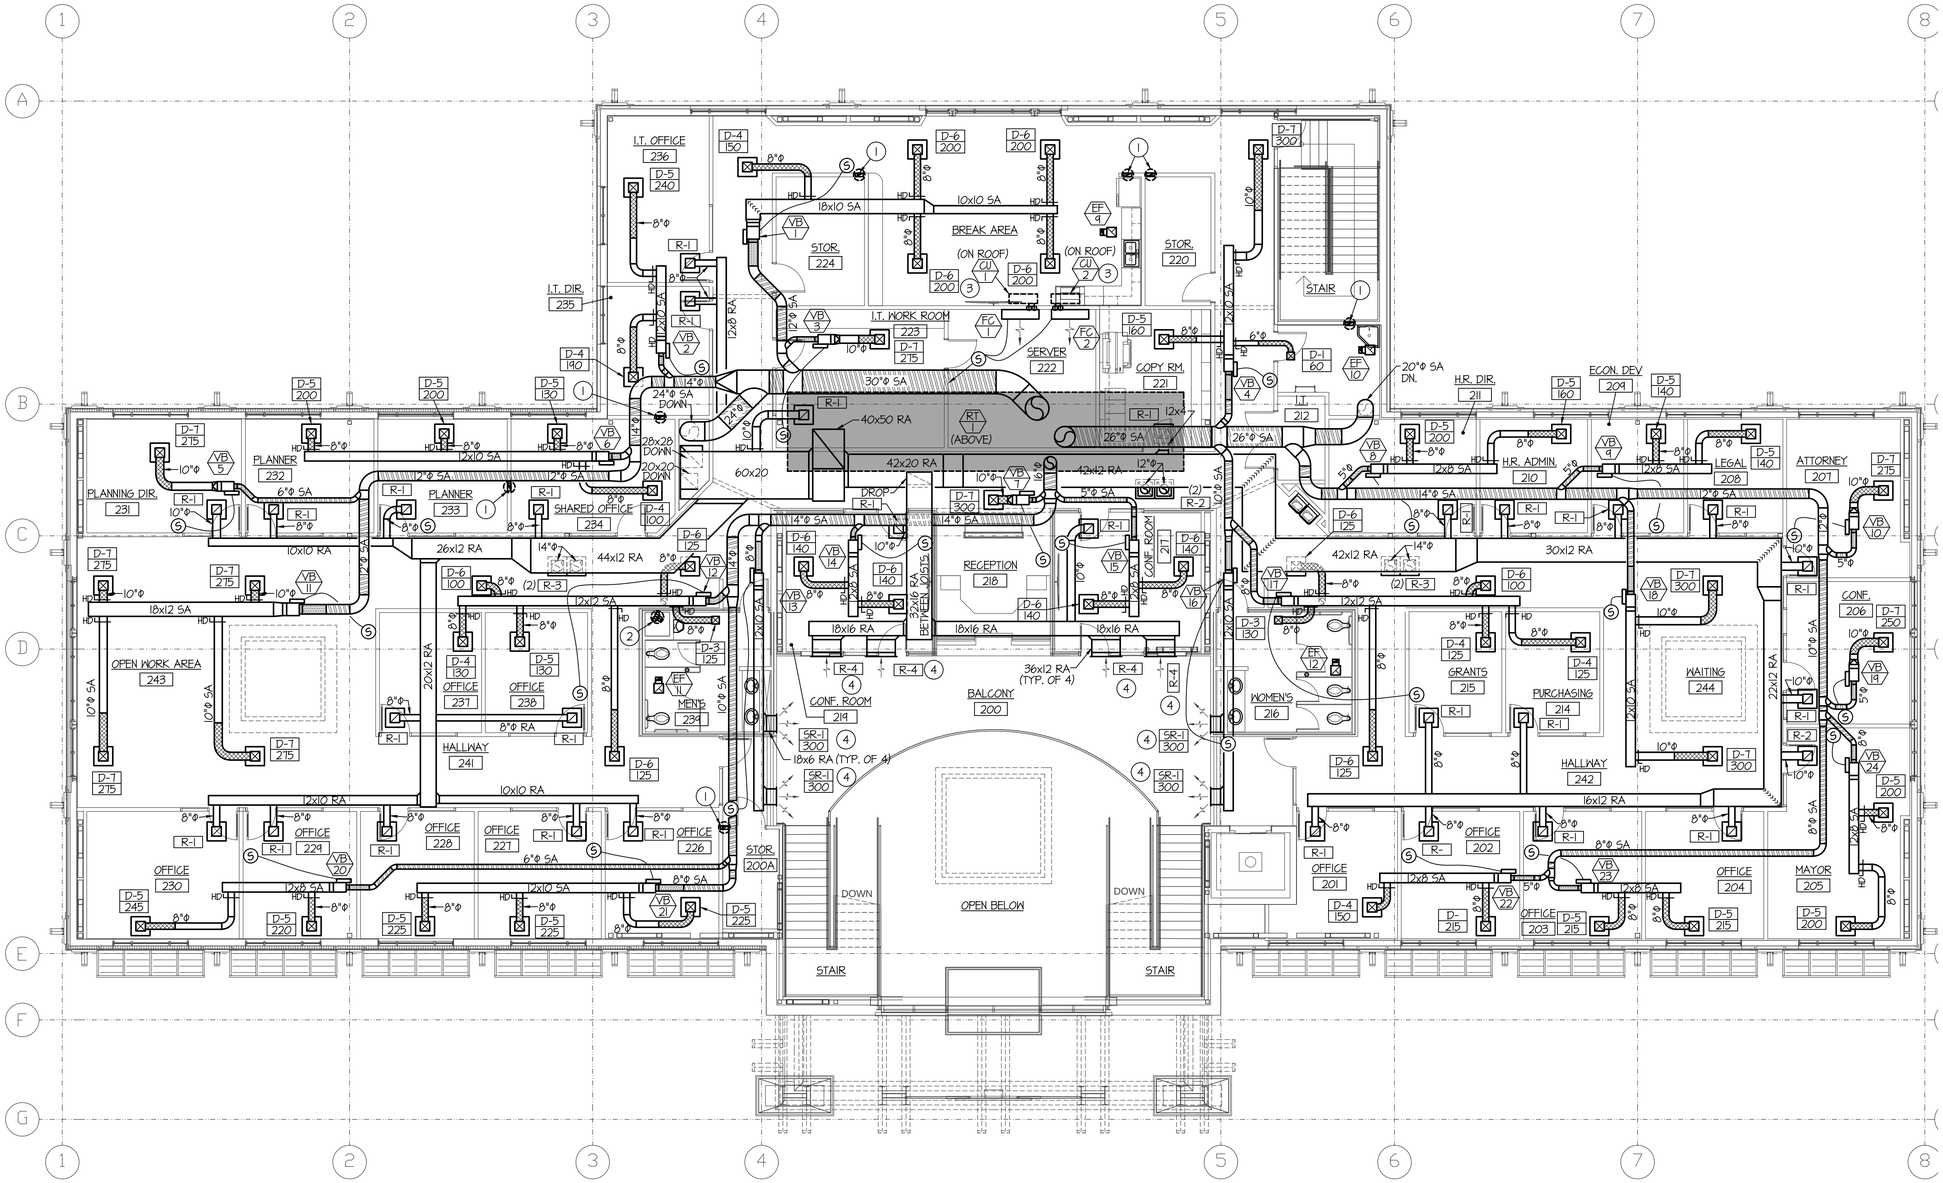

SECOND FLOOR- MECHANICAL PLAN

SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. 10x3 EXHAUST DUCT UP FROM BELOW TO ROOF CAP ON ROOF ABOVE. SEAL ROOF PENETRATION WEATHERTIGHT.
2. RISE (2) 6"ø EXHAUST DUCTS AND (1) 8"ø EXHAUST DUCT UP FROM MAIN LEVEL IN CHASE TO ROOF CAP ON ROOF ABOVE. SEAL ROOF PENETRATION WEATHERTIGHT.
3. INSTALL CONDENSING UNIT ON ROOF AND RUN REFR. LINES DOWN THRU ROOF AND CONNECT TO FAN COIL UNIT IN SERVER ROOM. SEAL ROOF PENETRATION WEATHERTIGHT. SEE DETAILS ON SHEET M201.
4. INSTALL GRILLE / REGISTER AT 11'-4" A.F.F TO CENTER OF GRILLE.

ORIGINAL DRAWING SIGNED BY: DWAYNE C. SUDWEEKS
DATE ORIGINAL SIGNED: FEB. 14, 2020
ORIGINAL ON FILE AT ENGINEERED SYSTEMS ASSOCIATES
1355 EAST CENTER, POCATELLO, IDAHO 83201

PROFESSIONAL ENGINEER REGISTERED 5762 STATE OF IDAHO DWAYNE C. SUDWEEKS

Engineered Systems Associates
1355 EAST CENTER
POCATELLO, IDAHO 83201
PHONE: (208) 233-0501
FAX: (208) 233-0529
EMAIL: esa@engsystems.com
ESA JOB NUMBER: 18080

Myers ■ Anderson
■ Architecture
■ Interior Design
■ Landscape Architecture
101 North Main Street ■ Pocatello, Idaho 83204 ■ tel. (208) 232 - 3741 ■ fax (208) 232 - 3782
849 Front Street, Suite 202 ■ Evanston, Wyoming 82930 ■ tel. (307) 789 - 0934
AIA NCARB ASLA

PROJECT:
CHUBBUCK CITY HALL
CHUBBUCK, IDAHO

SHEET TITLE:
SECOND FLOOR MECHANICAL PLAN

CONTRACTOR SHALL VERIFY ALL DIMENSIONS & CONDITIONS SHOWN OR IMPLIED

DRAWING SCALE APPLIES TO 22" X 34" SHEET SIZE

REVISION	DATE

DRAWN BY: SR
CHECKED BY: DCS
JOB NUMBER: 96548-13B
PROJECT DATE: FEB. 2020
SHEET M101 OF -