




A BACK-FLOW PREVENTER DETAIL NO SCALE

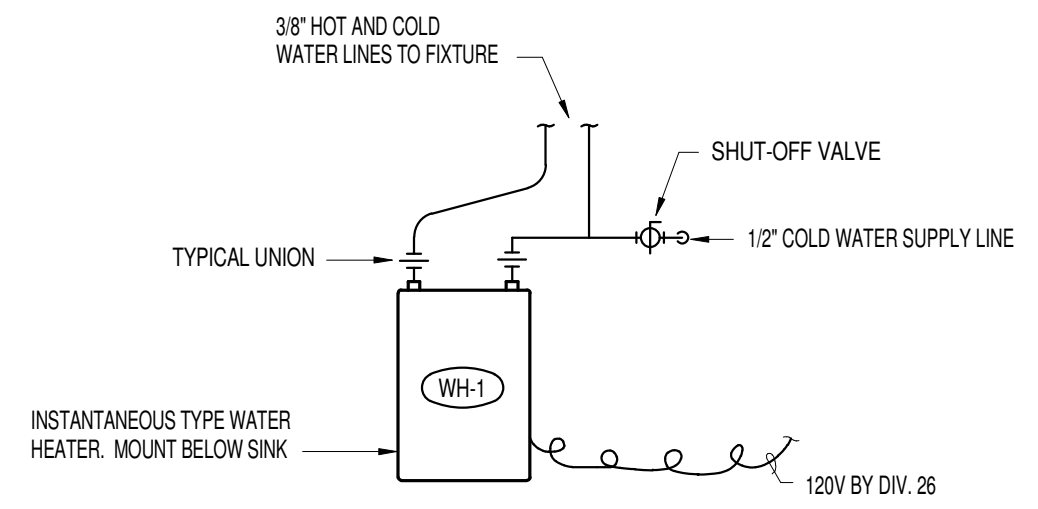


B TANKLESS WATER HEATER PIPING DETAIL NO SCALE

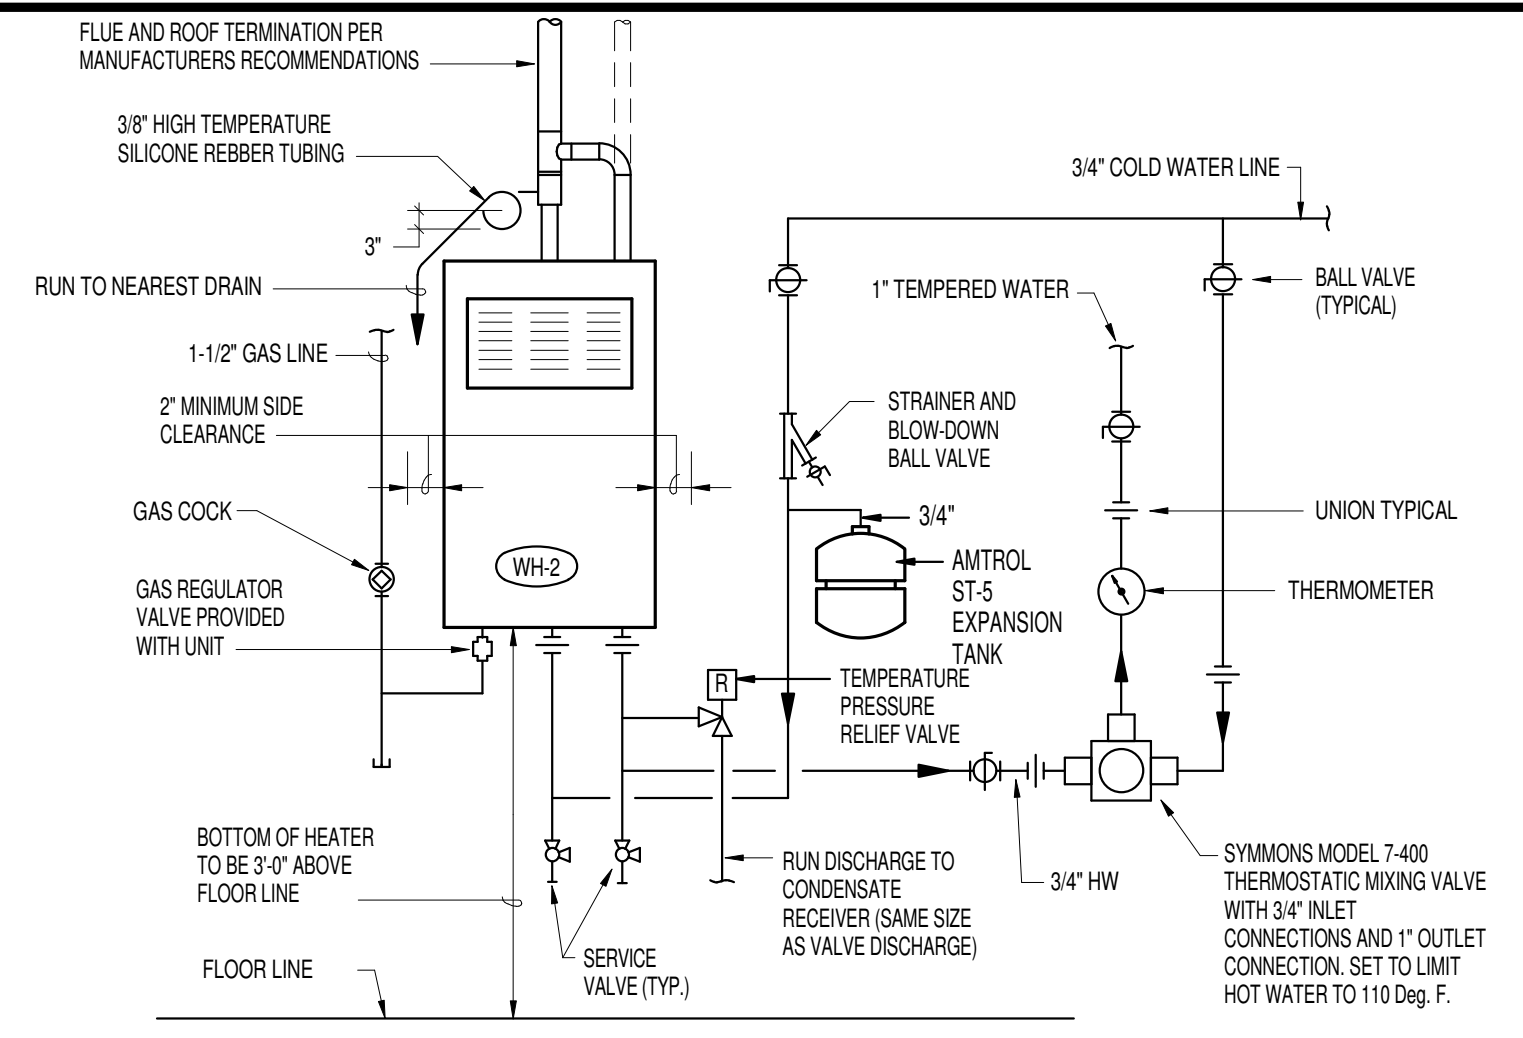


C TANKLESS WATER HEATER & MIXING VALVE NO SCALE

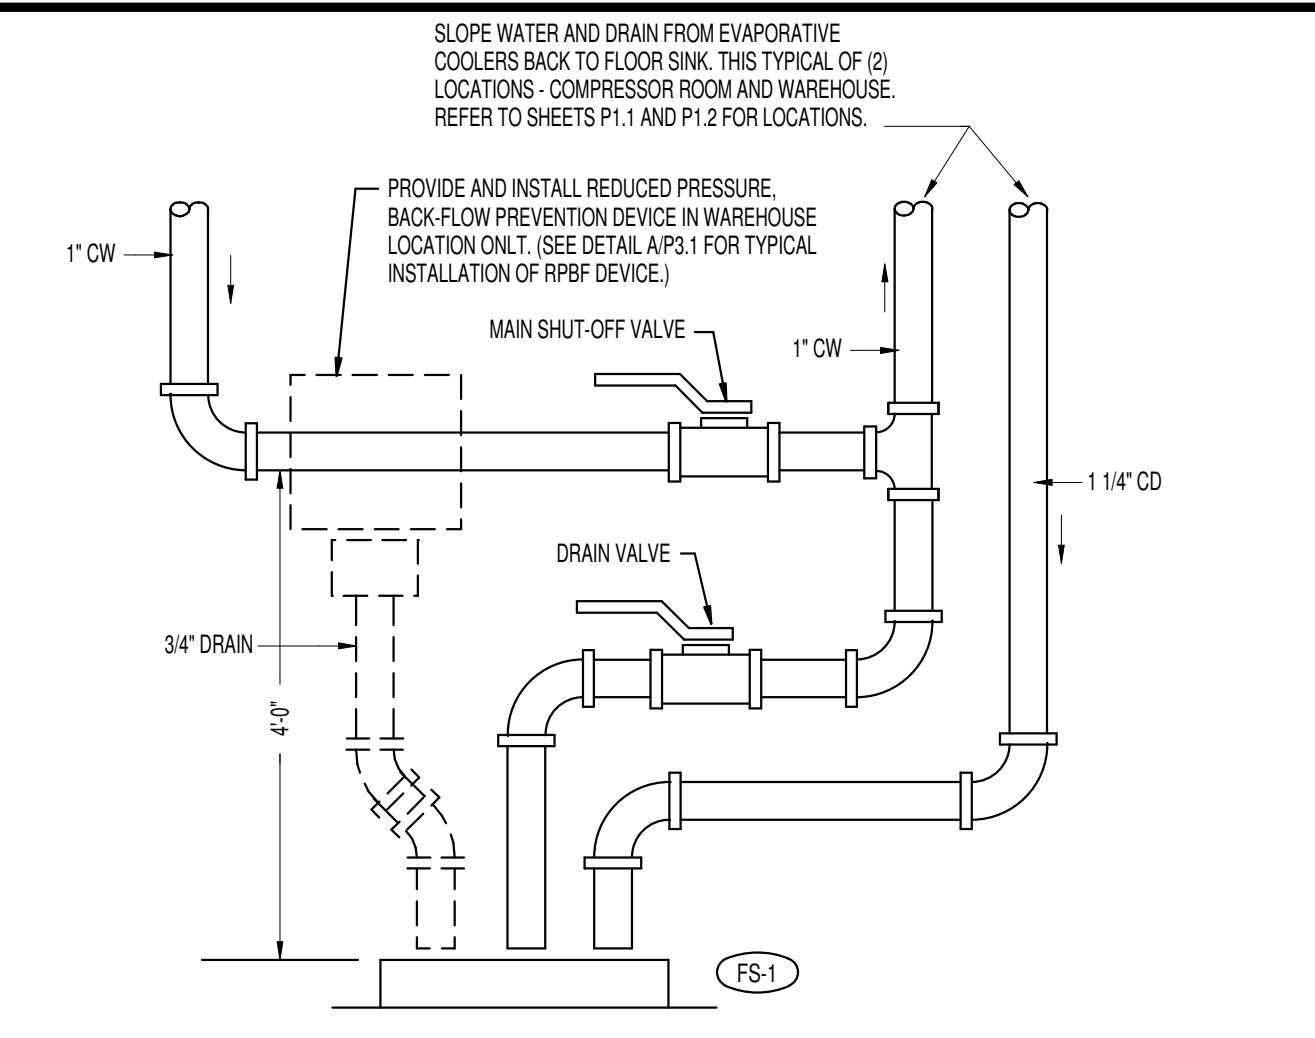


D EVAPORATIVE COOLER VALVE DIAGRAM NO SCALE

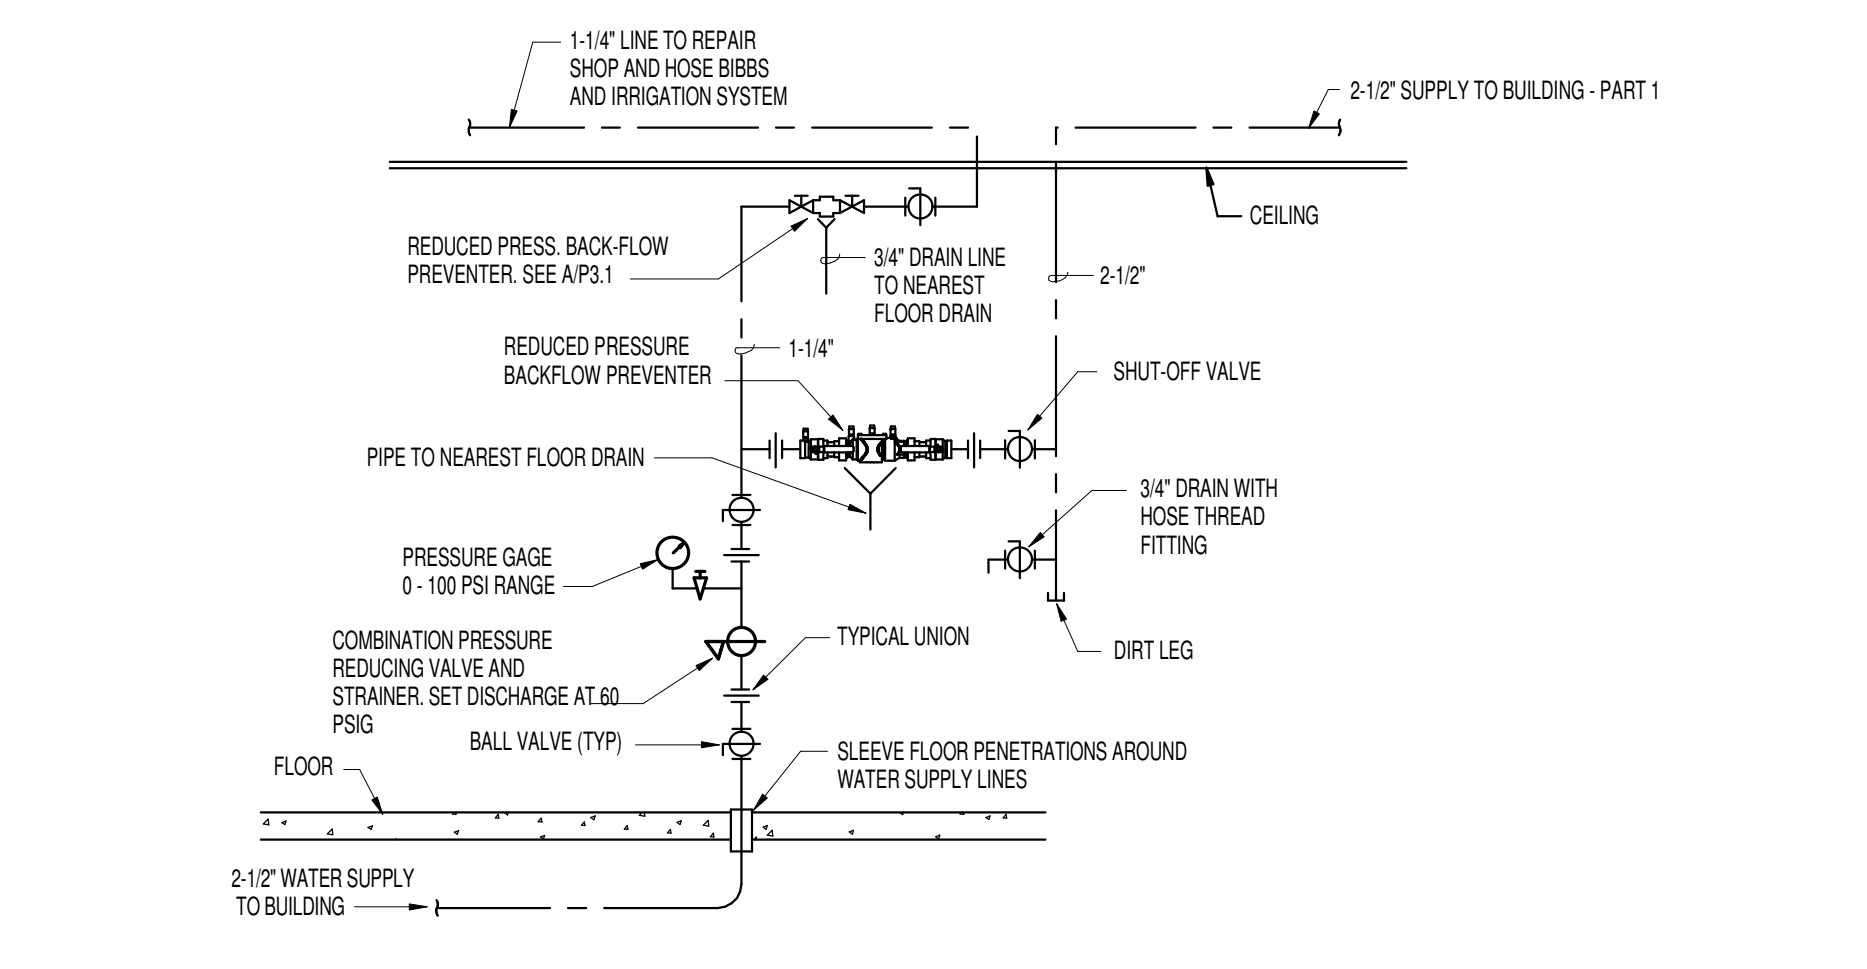


E WATER PRESSURE REDUCING STATION NO SCALE

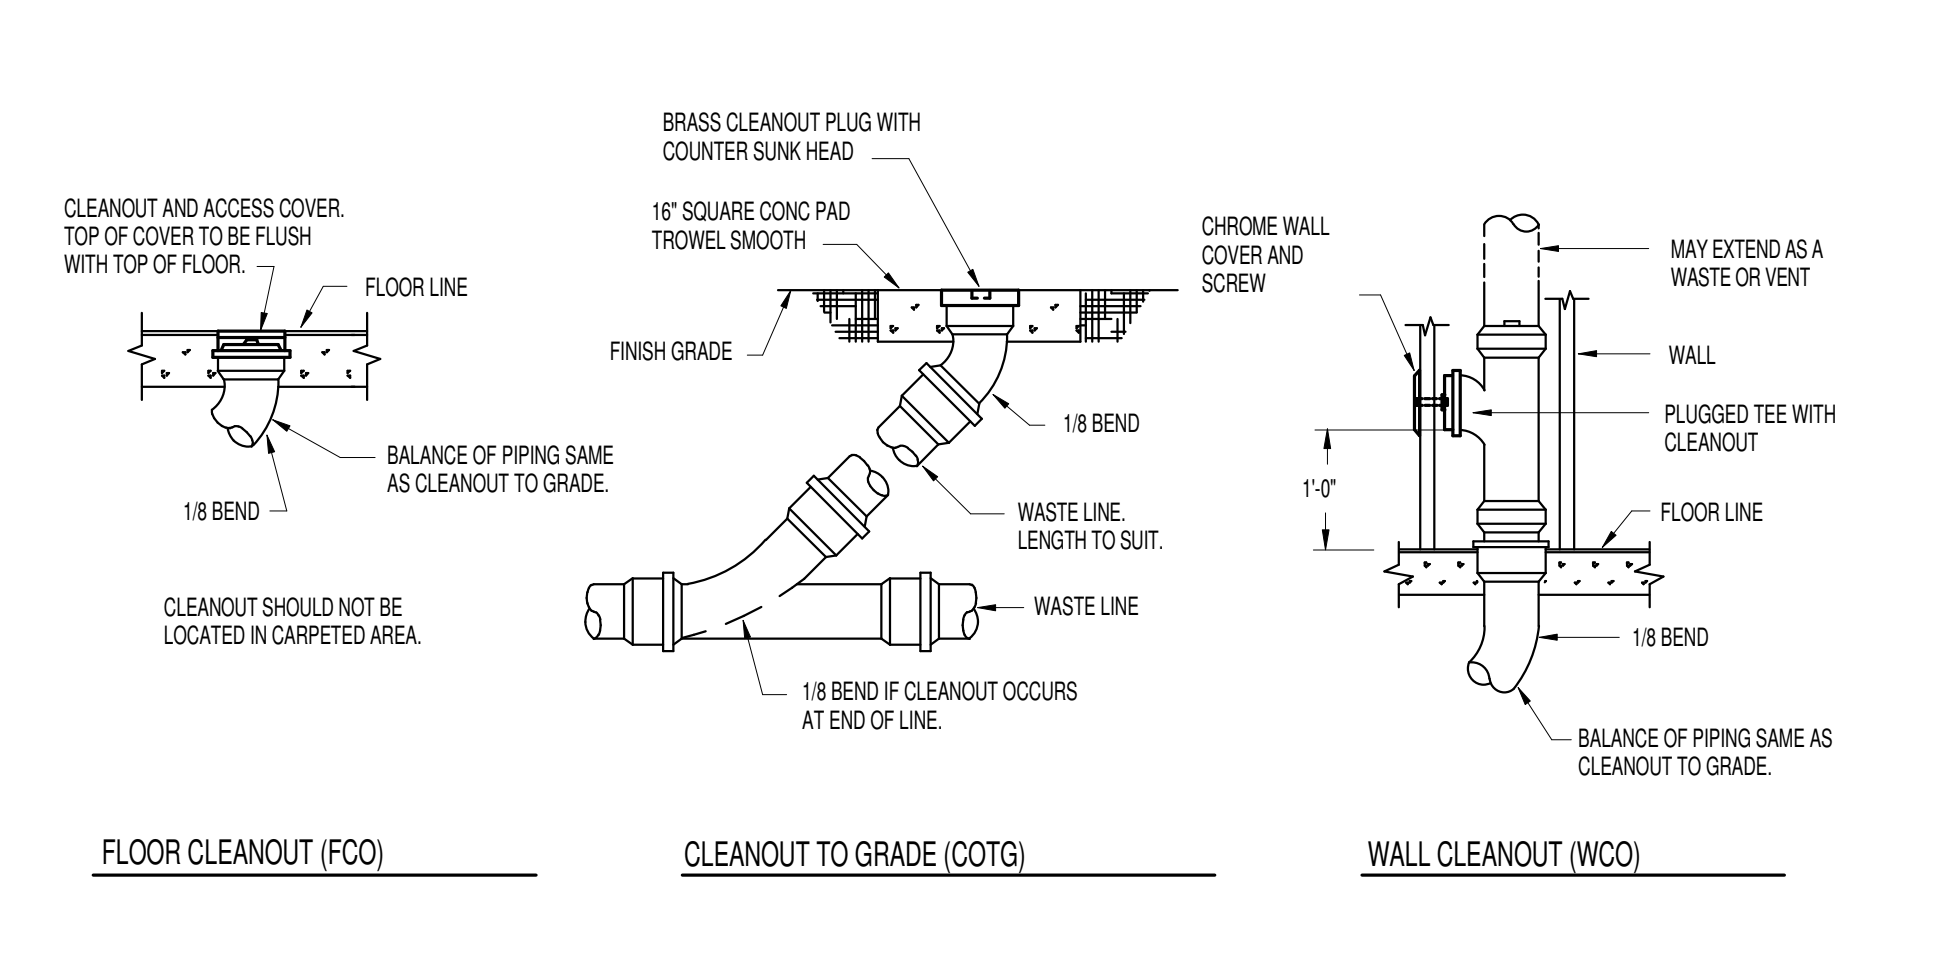


F CLEAN OUT DETAILS NO SCALE

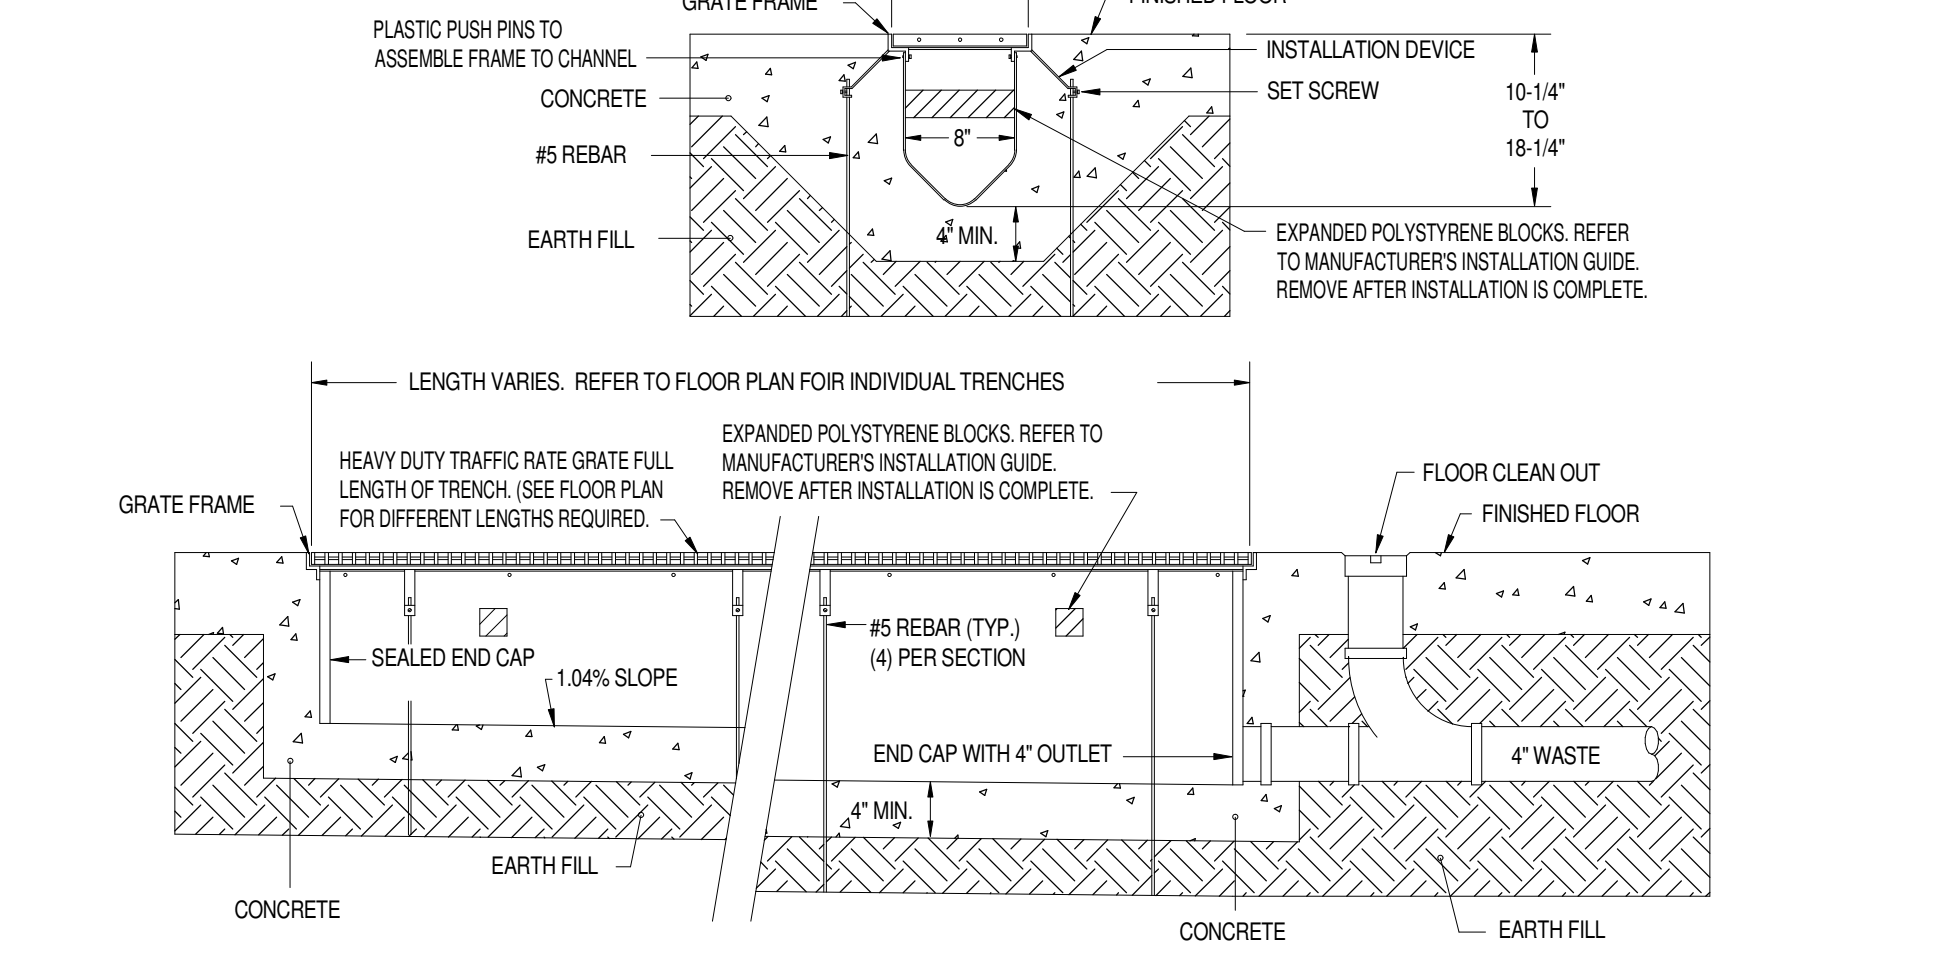


G TRENCH DRAIN INSTALLATION DETAILS NO SCALE

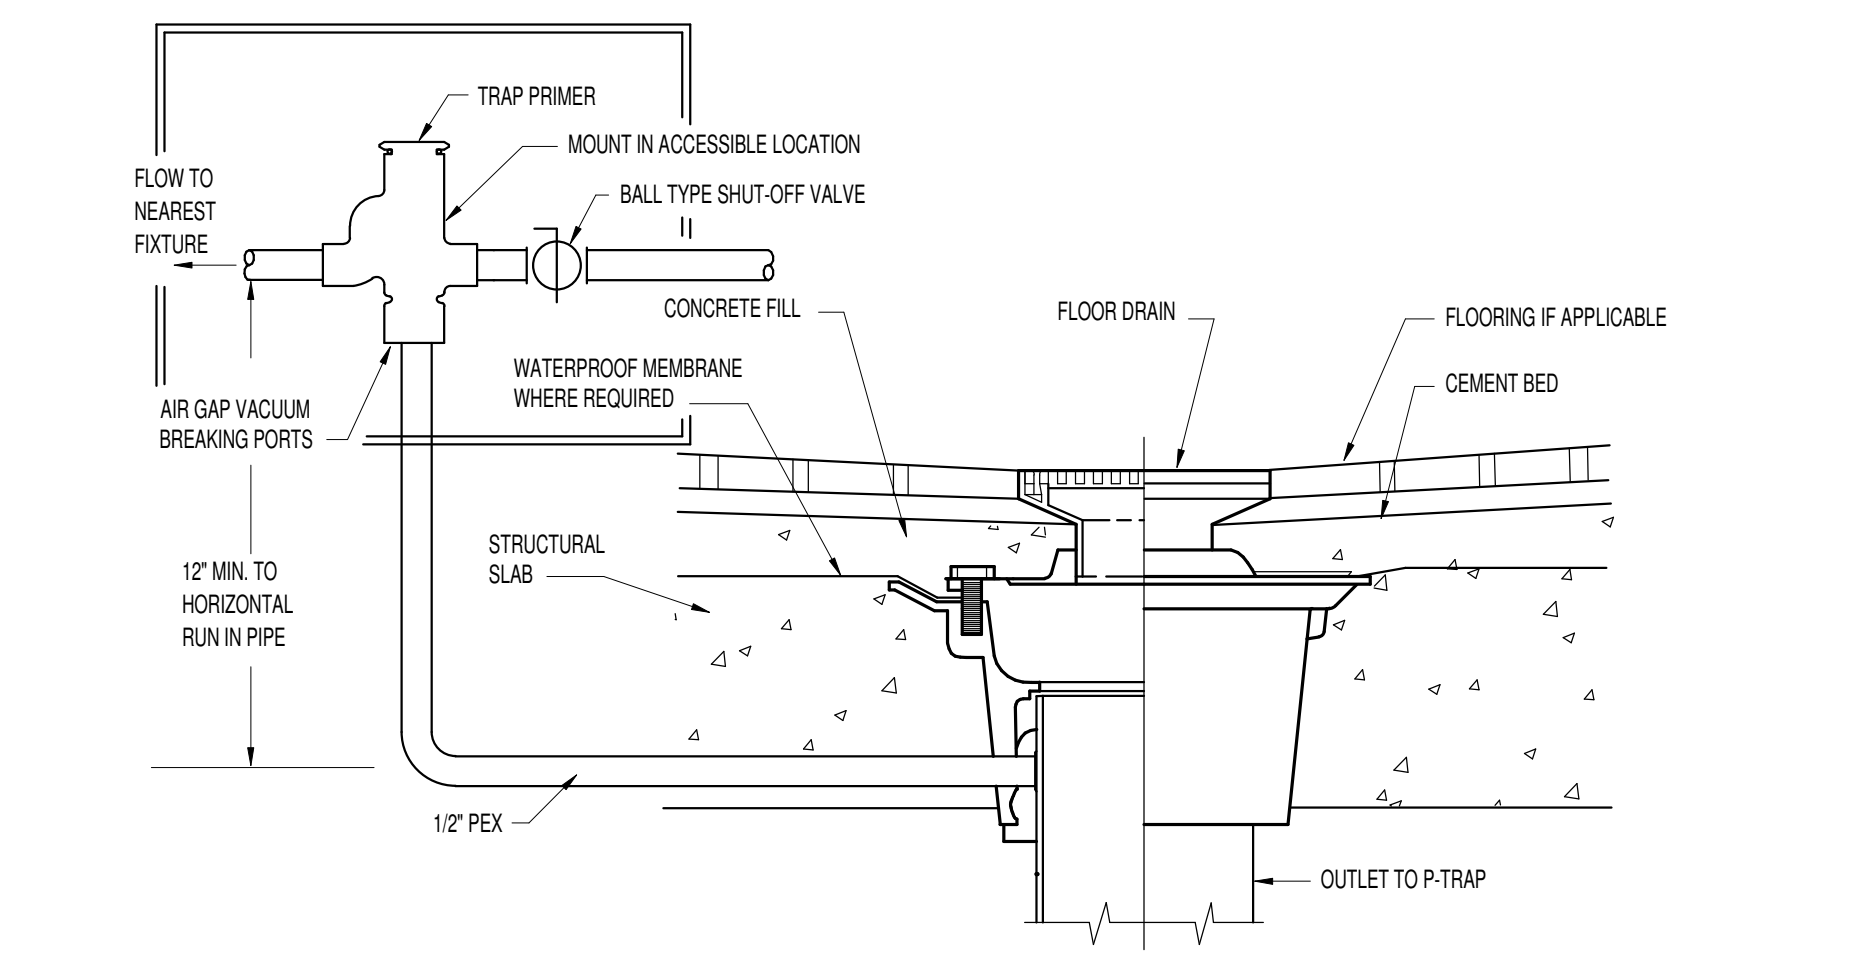


H TRAP PRIMER DETAIL NO SCALE

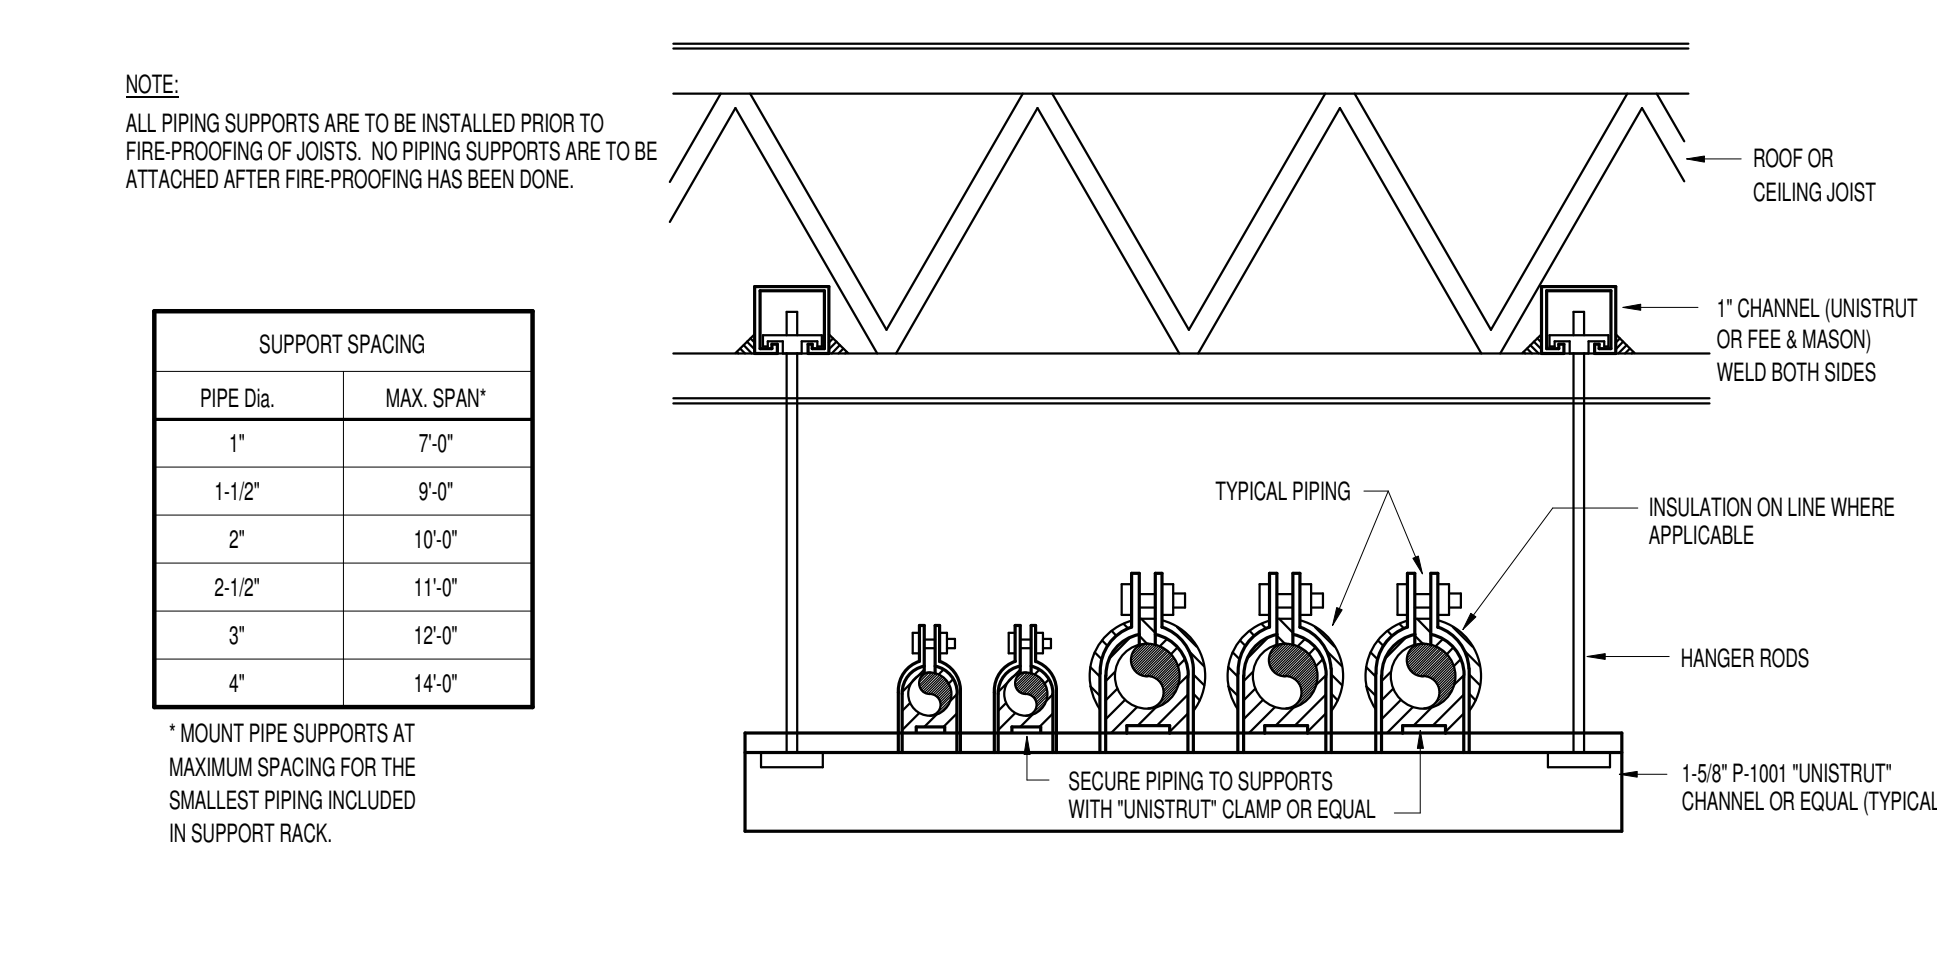


J PIPE SUPPORT DETAIL NO SCALE

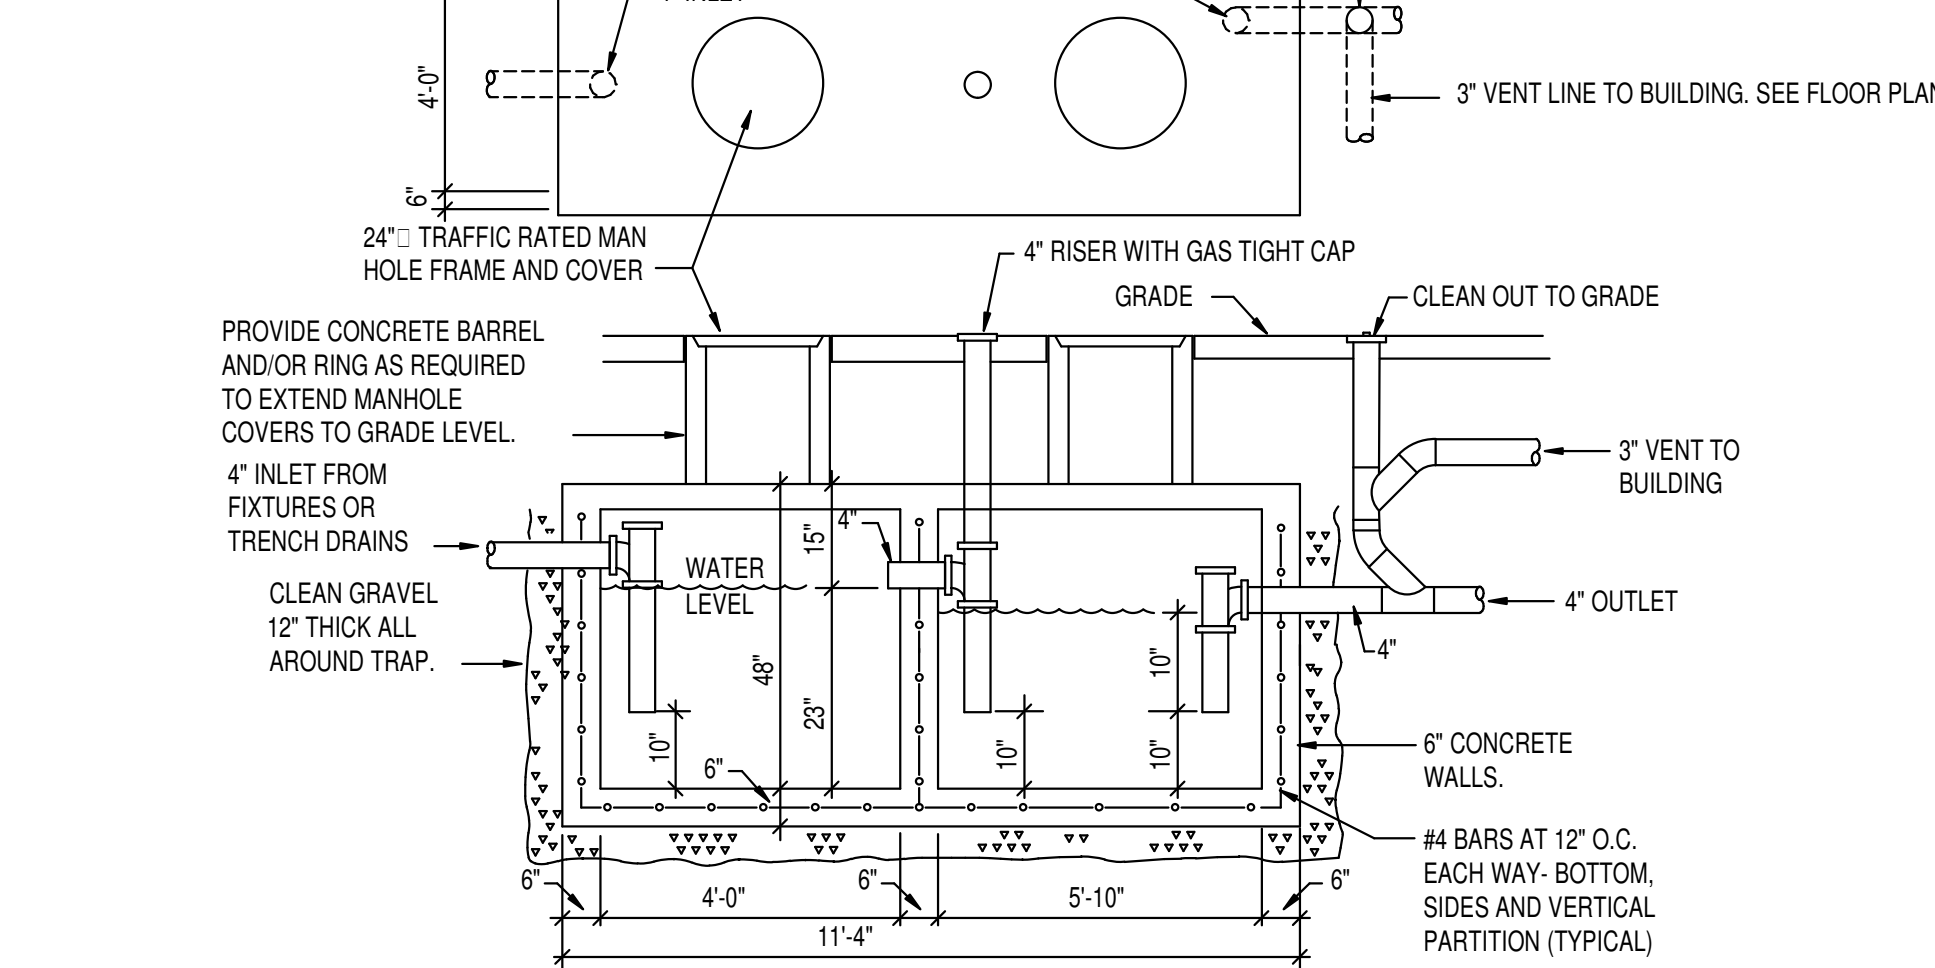

K SAND AND GREASE TRAP DETAIL NO SCALE

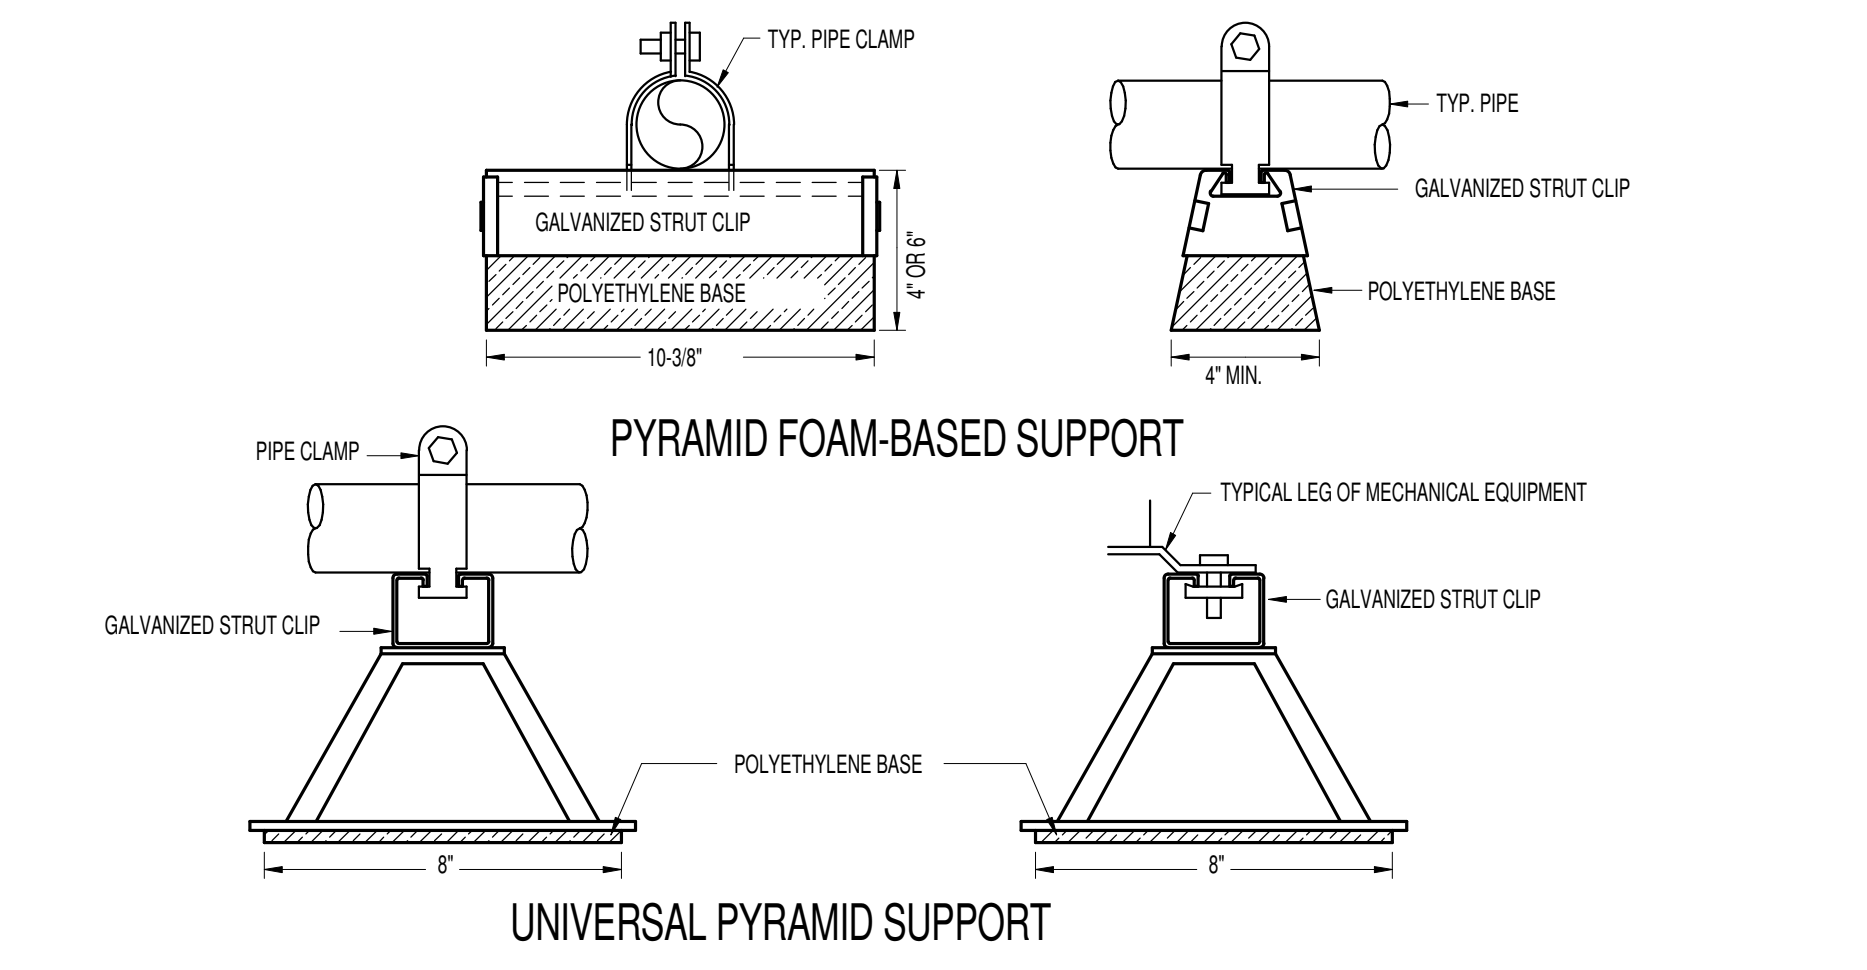

L EQUIPMENT AND PIPING ON ROOF SUPPORT DETAILS NO SCALE

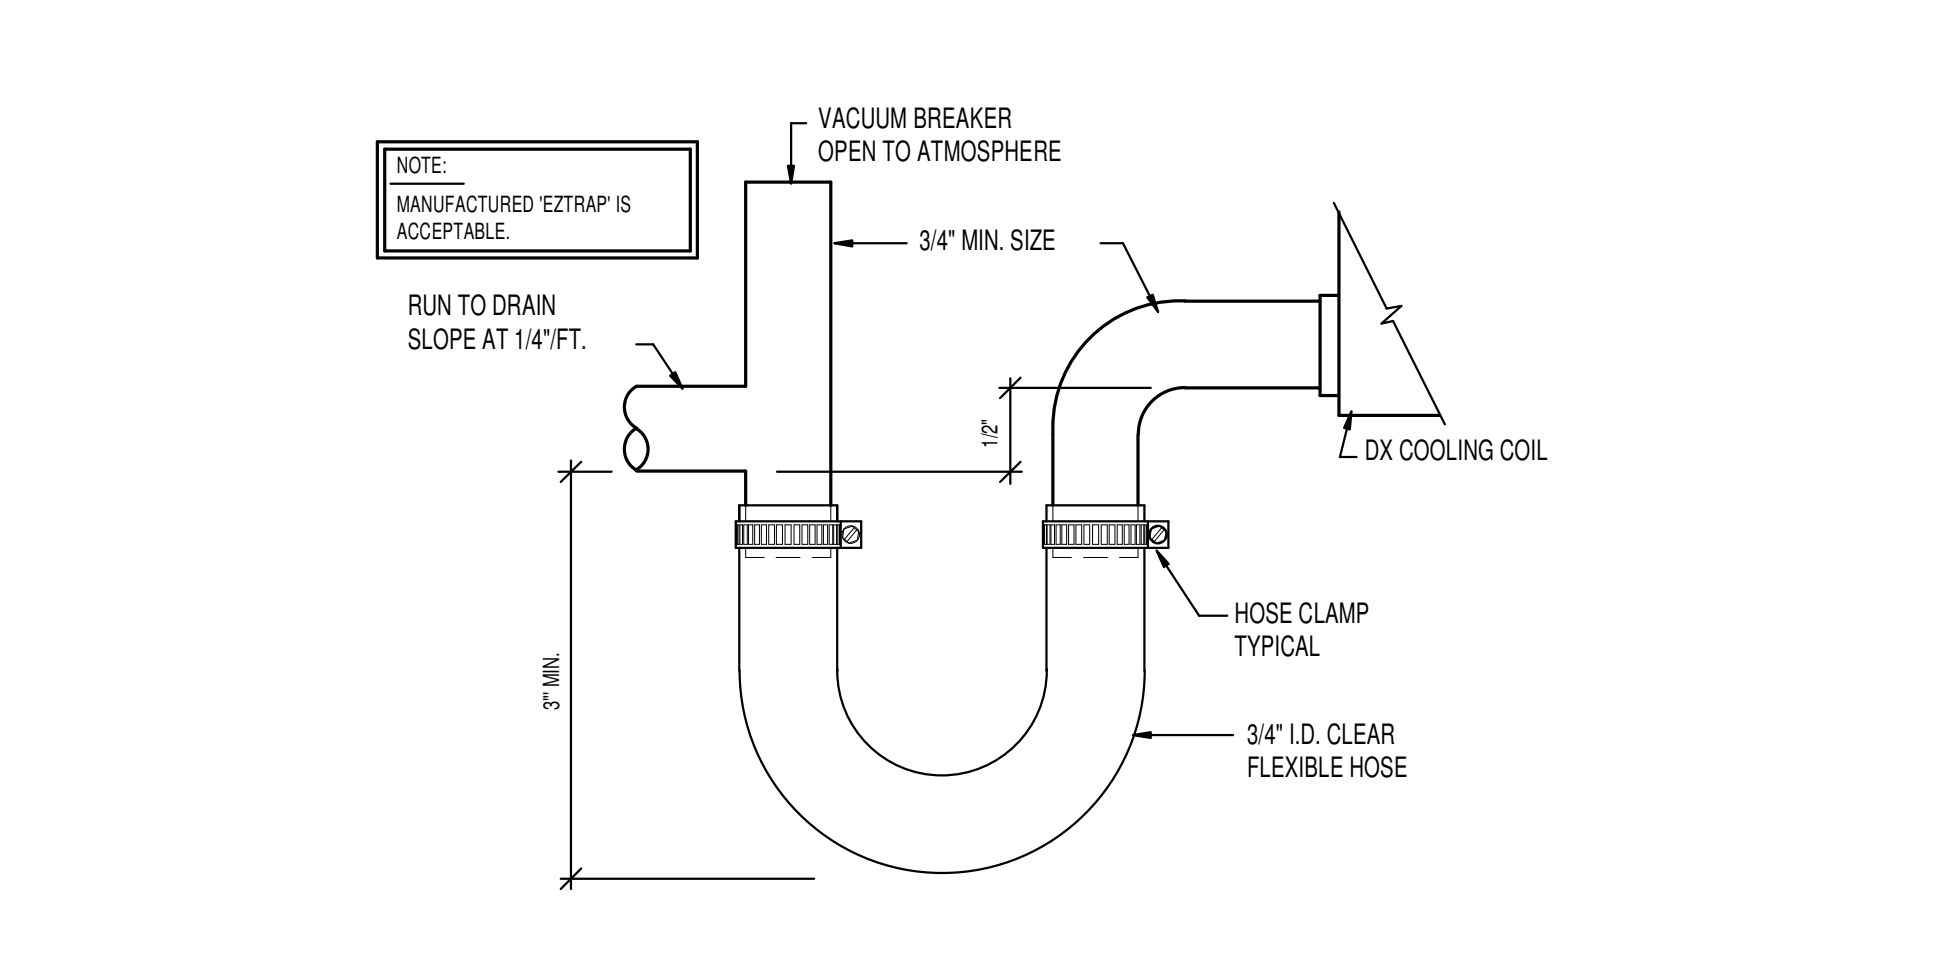

M DX COIL CONDENSATE DRAIN DETAIL NO SCALE

GENERAL NOTES:

- THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND CONNECTIONS ON THE JOB SITE. ALL WORK SHALL BE EXECUTED FROM MEASUREMENTS TAKEN AT THE SITE.
- THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO INSURE PROPER CODE CLEARANCES FOR ELECTRICAL AND MECHANICAL ACCESS WHEN INSTALLING ANY EQUIPMENT SUPPLIED BY THE MECHANICAL CONTRACTOR.
- IT IS CRITICAL THAT THIS CONTRACTOR COORDINATE EQUIPMENT LOCATIONS WITH PIPING, DUCTWORK, ELECTRICAL CONDUIT AND BUILDING STRUCTURE TO INSURE CODE COMPLIANCE.
- CEILING DIFFUSERS ARE SHOWN IN APPROXIMATE LOCATIONS. REFER TO LIGHTING PLANS AND REFLECTED CEILING PLAN FOR EXACT LOCATIONS.
- DUCT DIMENSIONS CALLED OUT ON DRAWINGS ARE INSIDE FREE AREA DIMENSIONS. ACOUSTICAL DUCT LINER ARE TO BE ADDED TO OVERALL MEASUREMENTS.
- ALL DUCTWORK AND PIPING WHICH PASSES THRU FIRE RATED WALLS TO BE FIRE STOPPED WITH APPROVED FOAM OR SEALANT. REFER TO SPECIFICATIONS FOR APPROVED MANUFACTURERS.

Engineered Systems Associates
 1355 EAST CENTER
 POCATELLO, IDAHO 83201
 PHONE: (208) 233-0501
 FAX: (208) 233-0529
 EMAIL: esa@engsysleims.com
 ESA JOB NUMBER: 19035

PROJECT NO. 16066
 DATE: NOVEMBER 2019
 DRAWN BY: M Jensen
 CHECKED BY: D Sudweeks
 DRAWING NO.: **P3.1**

nw architects p.a.
 ARCHITECTURE / PLANNING / INTERIORS
 SCOTT L. NELSON, A.I.A., KEVIN R. BODILY, A.I.A., JAMES H. WYATT, A.I.A.
 990 JOHN ANDERSON PARKWAY, P.O. BOX 2212, IDAHO FALLS, IDAHO 83402-2212
 (208) 208-5322, (208) 725-8775 (208) 725-8775

A NEW BUILDING FOR:
KENWORTH SALES COMPANY INC.
 1750 SOUTH 1350 WEST
 NEW HAVEN, UTAH

PLUMBING DETAILS AND DIAGRAMS
 SHEET TITLE: