

PLAN NOTES:

- 1 DROP 16x14 SUPPLY AIR DUCT DOWN IN CHASE TO SERVE LEVELS BELOW. SEE SHEET M1-3 FOR CONTINUATION OF DUCTWORK.
- 2 REFRIGERANT PIPING UP IN WALL TO OUTDOOR UNIT OU-1 LOCATED ON ROOF ABOVE. SEE SHEET M1-5 FOR CONTINUATION OF PIPING ABOVE AND LOCATION OF OUTDOOR UNIT OU-1.
- 3 REFRIGERANT PIPING DOWN IN WALL FROM ROOFTOP FAN COIL UNIT FC-2B DOWN TO LEVEL 2 FAN COIL UNIT FC-2A.
- 4 INSTALL FIRE DAMPER IN 16x14 DUCT AT CHASE PENETRATION. WITH 12x12 ACCESS PANEL LOCATED ABOVE LAY-IN CEILING.
- 5 INSTALL FIRE DAMPER IN 20x10 SA DUCT AT FLOOR PENETRATION. INSTALL 12x12 ACCESS PANEL AT 12' A.F.F. ON SOUTH SIDE OF CHASE.

05.06.22

DATE

A NEW HOTEL:
HOTEL
TWIN FALLS, ID.
4TH LEVEL MECHANICAL FLOOR PLAN

Laughlin Ricks Architecture
—architecture/planning—
134 3RD AVE. E. * Twin Falls, Idaho 83301
(208) 736-8050 Fax: (208) 733-0950


DATE: 5/06/2022
DR: [Signature] DLH
Checked

M1-4

PROFESSIONAL ENGINEER
18184
May 06, 2022
STATE OF IDAHO
DAVID L. HANSEN

Engineered Systems Associates

1355 EAST CENTER
POCATELLO, IDAHO 83201
PHONE: (208) 233-0501
FAX: (208) 233-0529
EMAIL: esa@engsystems.com
ESA JOB NUMBER: 22017

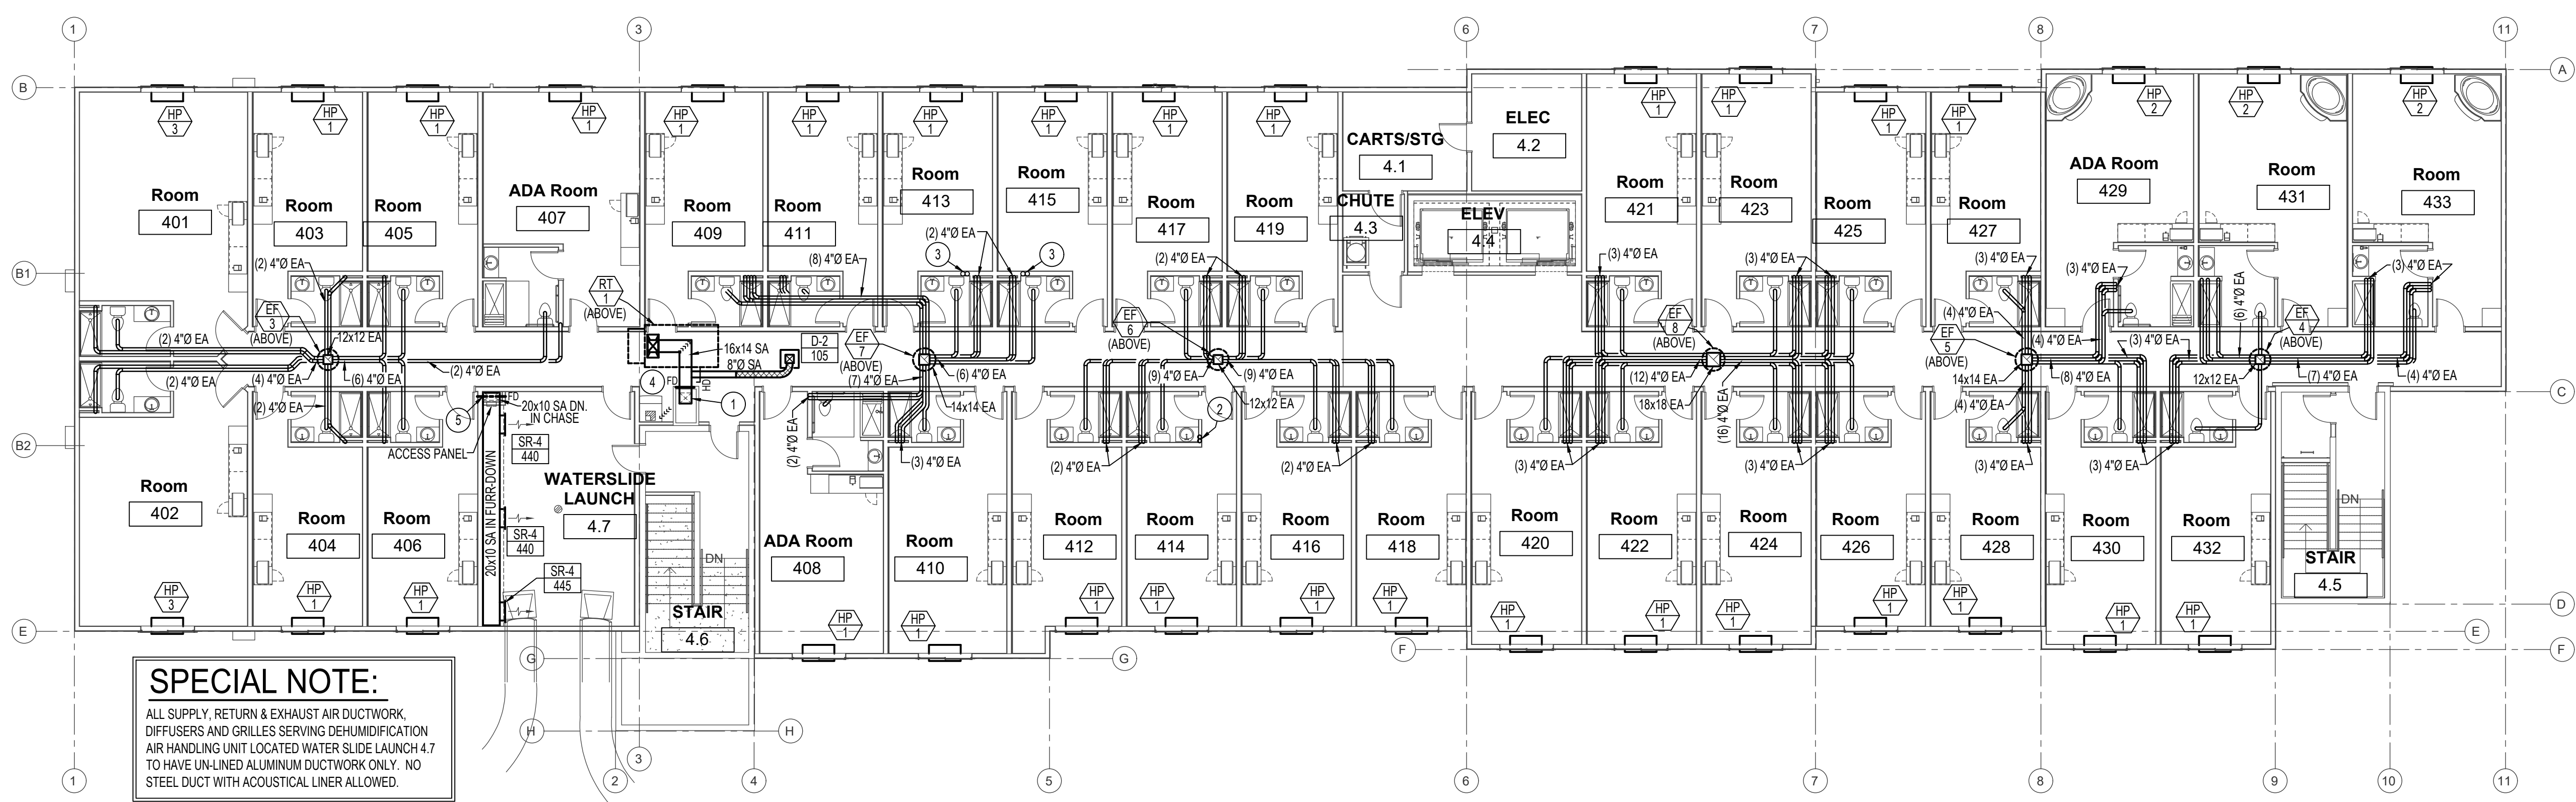

SPECIAL NOTE:
ALL SUPPLY, RETURN & EXHAUST AIR DUCTWORK, DIFFUSERS AND GRILLES SERVING DEHUMIDIFICATION AIR HANDLING UNIT LOCATED WATER SLIDE LAUNCH 4.7 TO HAVE UN-LINED ALUMINUM DUCTWORK ONLY. NO STEEL DUCT WITH ACOUSTICAL LINER ALLOWED.

4TH LEVEL - MECHANICAL FLOOR PLAN
SCALE: 3/32" = 1'-0"

NOTE:
SEE LARGE SCALE TYP. GUEST ROOM MECH. PLANS ON SHEETS M2-0 FOR DUCTWORK & EQUIPMENT SERVING INDIVIDUAL GUEST ROOM TYPES.