


ROOF LEVEL - MECHANICAL FLOOR PLAN
 SCALE: 3/32" = 1'-0"

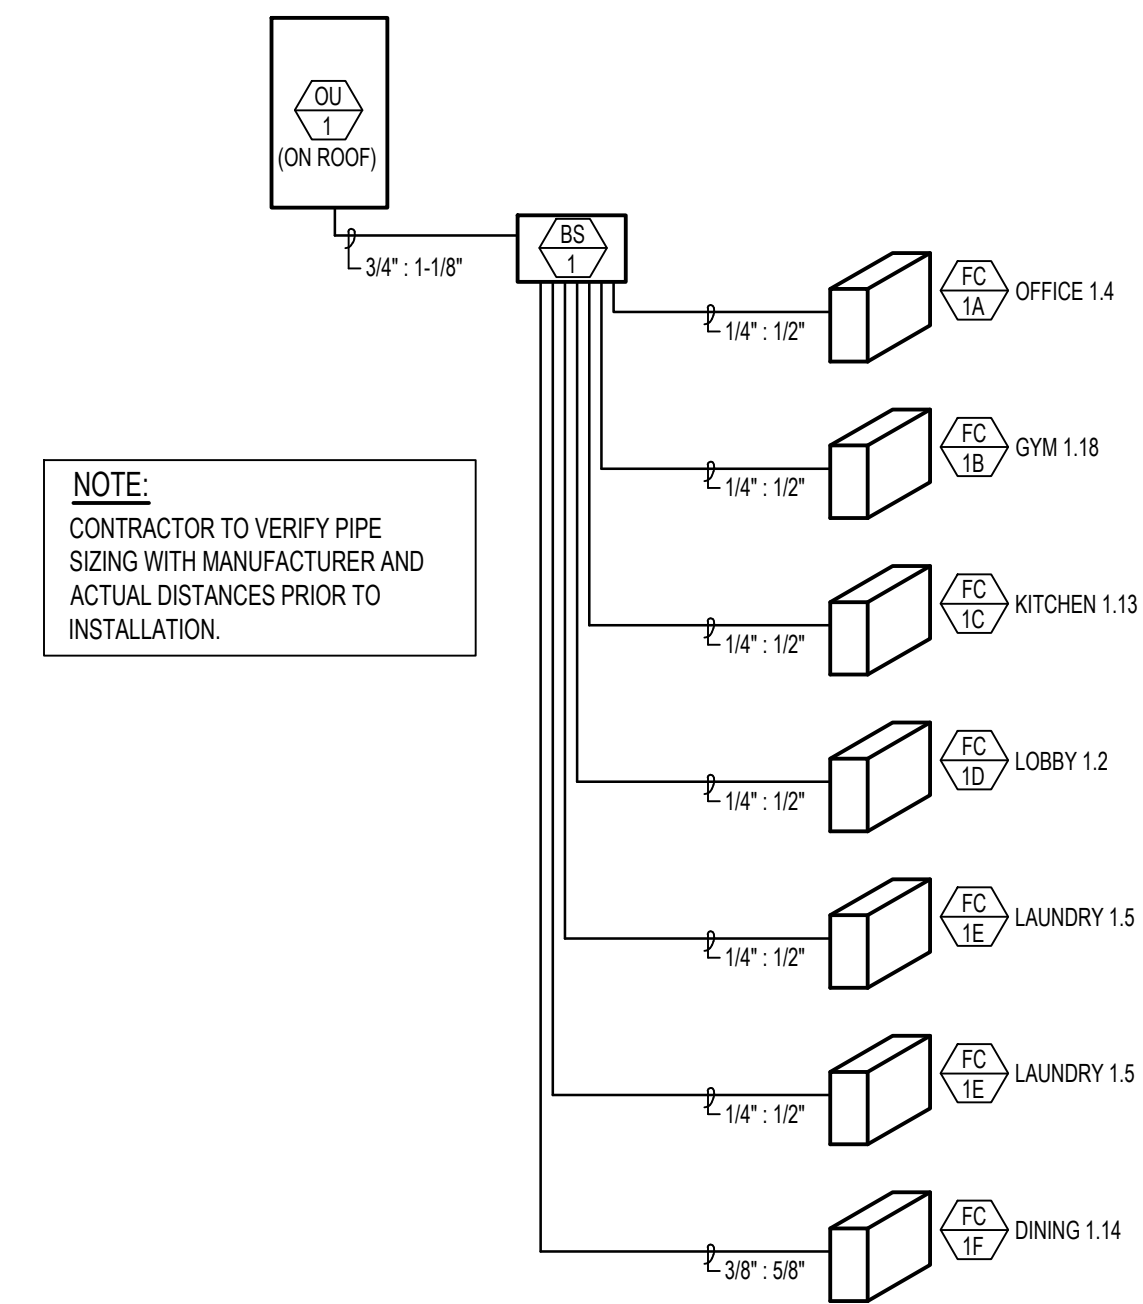

NOTE:
 CONTRACTOR TO VERIFY PIPE SIZING WITH MANUFACTURER AND ACTUAL DISTANCES PRIOR TO INSTALLATION.

VRF REFRIGERANT PIPING DIAGRAM
 NO SCALE

PLAN NOTES:
 1 DROP REFRIGERANT PIPING THRU ROOF IN GOOSENECK ASSEMBLY. SEAL ROOF PENETRATIONS WEATHERTIGHT. SEE DETAIL ON SHEET M3-0.

DATE: 05.06.22

DATE: _____

A NEW HOTEL:
 HOTEL
 TWIN FALLS, ID.
 ROOF LEVEL MECHANICAL FLOOR PLAN

Laughlin Ricks Architecture
 architecture/planning
 134 3RD AVE. E. * Twin Falls, Idaho 83301
 (208) 736-8050 Fax: (208) 733-0950

Engineered Systems Associates
 1355 EAST CENTER
 POCAHELLO, IDAHO 83201
 PHONE: (208) 233-0501
 FAX: (208) 233-0529
 EMAIL: esa@engsystems.com
 ESA JOB NUMBER: 22017

PROFESSIONAL ENGINEER
 REG. NO. 18184
 May 06, 2022
 STATE OF IDAHO
 DAVID L. HANSEN

DATE: 5/06/2022
 DR: _____
 DWG: _____
 Checked: _____
M1-5