



MECHANICAL LEVEL 1
SCALE: 1/4" = 1'-0"

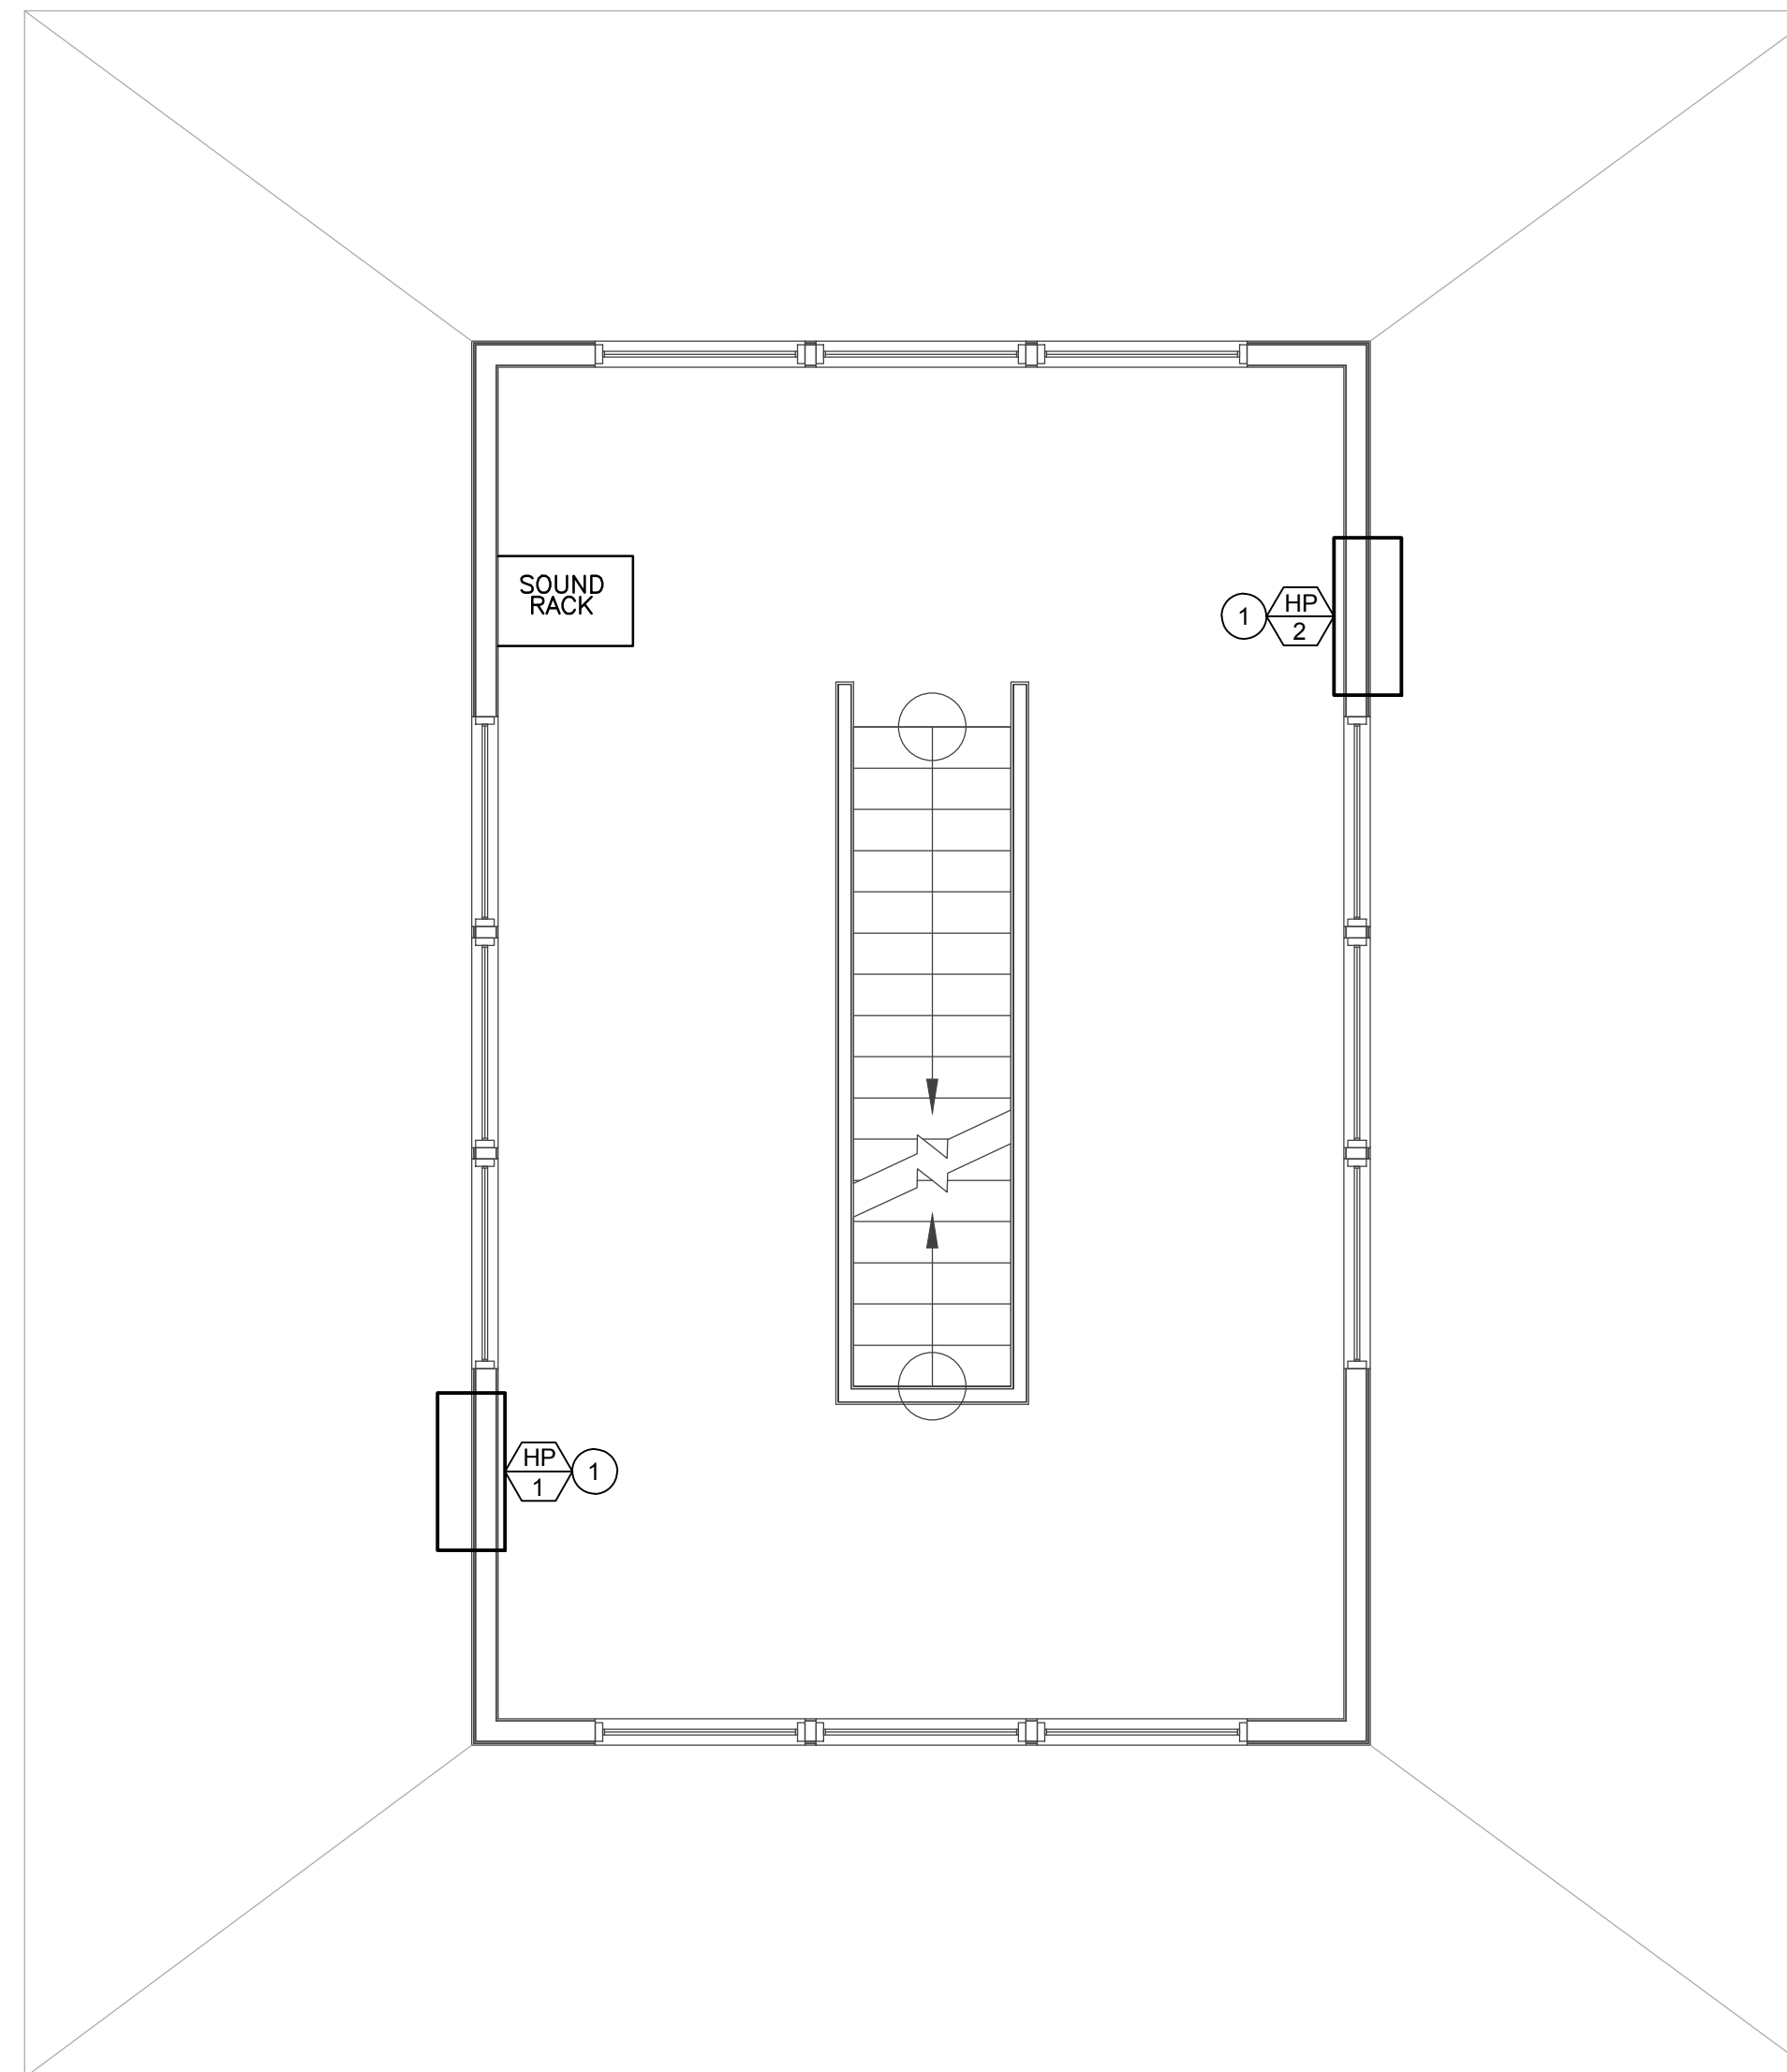

MECHANICAL LEVEL 2
SCALE: 1/4" = 1'-0"

PLAN NOTES:

- 1 INSTALL THRU THE WALL HEAT PUMP ABOVE LOWER LEVEL ROOF STRUCTURE. SEE DETAIL ON SHEET M201.
- 2 RUN EXHAUST DUCT UP THRU ROOF TO SLOPED ROOF CAP ON SHINGLED ROOF. SEE DETAIL ON SHEET M201.

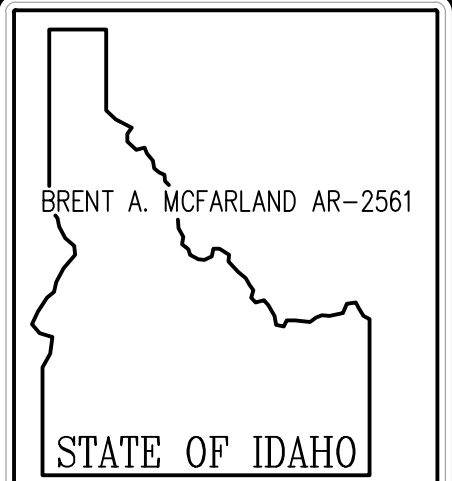

CONSULTANTS:
MECHANICAL ENGINEERING
ENGINEERED SYSTEMS ASSOC.
1355 East Center 83201
Pocatello, Idaho (208) 233-0501
Fax (801) 233-0529
ELECTRICAL ENGINEERING
PAYNE ENGINEERING INC.
1823 E. Center St.
Pocatello, Idaho 83201
(208) 232-4439
Fax (208) 232-1435

MECHANICAL LEGEND	
SYMBOL	DESCRIPTION
EA	EXHAUST AIR
T	REMOTE THERMOSTAT
EH	CEILING MOUNTED EXHAUST FAN
1	PLAN NOTE
EH 1	EQUIPMENT SYMBOL

PROJECT: **MADISON BASEBALL BOOTH**
DRAWING TITLE: **MECHANICAL FLOOR PLANS**

REVISION:		
#	DATE	COMMENT
DRAWN BY:	JOB NO:	
TP	-	
CHECKED BY:	DATE:	
DCS	09/16/2022	
PLOT DATE: 09-16-22		

PROFESSIONAL ENGINEER
LICENSED
Tanner C. Davis
STATE OF IDAHO
Sep 16, 2022

Engineered Systems Associates
1355 EAST CENTER
POCATELLO, IDAHO 83201
PHONE: (208) 233-0501
EMAIL: eso@engsystems.com
ESA JOB NUMBER: 22137

DRAWING NO. FILE: 22137 Madison Baseball Booth M101.dwg
M101
OF 4