

# ADDENDUM

---

Project: Shawnee HVAC Replacement

Property No.: 5258391

Addendum No.: 1

Project Address: 5001 W Shawnee Ave, Spokane, WA 99208

Date: June 5<sup>th</sup>, 2023

Owner: The Church of Jesus Christ of Latter-day Saints, a Utah corporation  
sole

From (Engineer): Engineered Systems Associates

---

## Instructions to Prospective Bidders:

This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents and/or prior Addenda as noted below. All conditions, requirements, materials, and workmanship are to be as described in the Contract Documents unless specifically stated otherwise. This Addendum consists of 1 page(s) and a total of 1 attachment(s), for a total of 2 pages

---

### 1. Changes to prior Addenda:

- a. None

### 2. Changes to Bidding Requirements:

- a. None

### 3. Changes to Conditions of the Contract:

- a. None


### 4. Changes to Specifications:

- a. None

### 5. Changes to Drawings:

- a. Sheet ME-1: Condensing Units 1, 2, 5 & 6 have been field verified to not exist. This is just for reference, no work to be done with these units.
- b. Sheet ME-1: Mechanical rooms 107, 131, 143, & 161 do not have existing floor drains. Existing cooling condensate is piped through the wall. Install new scupper in exterior wall for furnace condensate. See attached detail A. Run PVC condensate from combustion to new scupper furnace.

**End of Addendum**

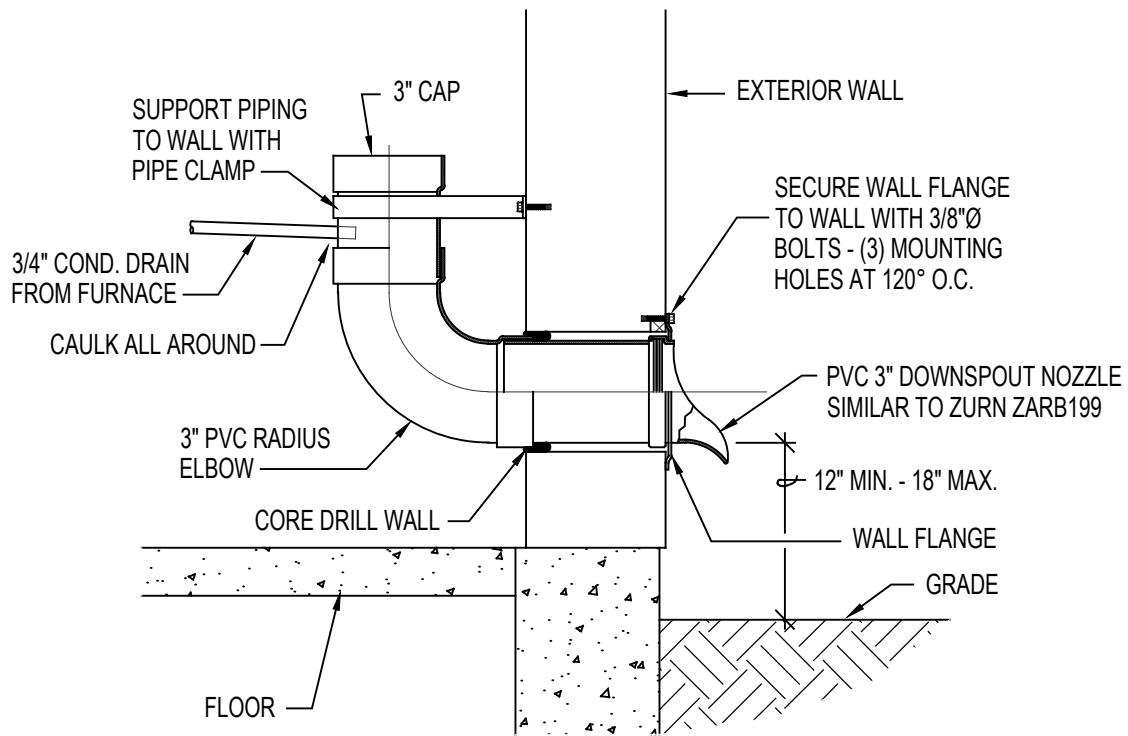

**A** **CONDENSATE DRAIN DETAIL**  
 NO SCALE